

Maximum Uplift Capacity U, Ibs. (kN)		
Wall top plate/min. thickness	Clip on one face+	Clip on each face
22g grade 33/0.0269 in. (0.68mm)	400 (1.78)	960 (4.27)
22g grade 50/0.0269 in. (0.68mm)	400 (1.78)	1390 (6.18)
20g grade 33/0.0328 in. (0.83mm)	400 (1.78)	1170 (5.20)
20g grade 50/0.0328 in. (0.83mm)	400 (1.78)	1700 (7.56)
18g grade 33/0.0428 in. (1.09mm)	400 (1.78)	1530 (6.81)
18g grade 50/0.0428 in. (1.09mm)	400 (1.78)	2210 (9.83)
16g grade 33/0.0538 in. (1.37mm)	400 (1.78)	1920 (8.54)
16g grade 50/0.0538 in. (1.37mm)	400 (1.78)	2770 (12.32)
14g grade 33/0.0677 in. (1.72mm)	400 (1.78)	2420 (10.76)
14g grade 50/0.0677 in. (1.72mm)	400 (1.78)	2870 (12.77)
12g grade 33/0.0966 in. (2.45mm)	400 (1.78)	2870 (12.77)
12g grade 50/0.0966 in. (2.45mm)	400 (1.78)	2870 (12.77)

+ Connections with clip on one face require web above connection.



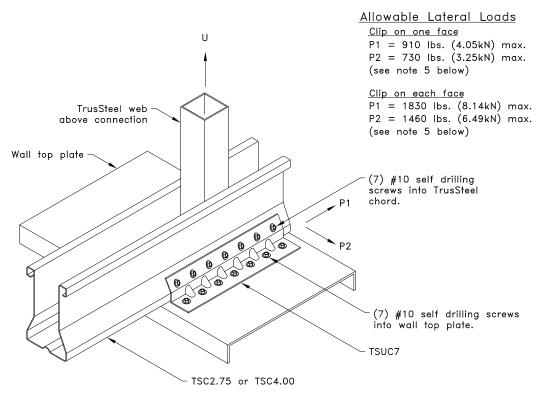

### **General Notes:**

- 1. Wall top plate shall be manufactured from Cold-Formed Steel (CFS) with minimum tensile strength of 45 KSI (310 MPa) and maximum width is 8" (203mm).
- 2. Attachment of second clip on opposite face of chord is identical to what is detailed.
- Connection of top plate to wall stud must be capable of transferring truss uplift load from wall top plate to wall stud.
- 4. The wall top plate is to be designed by the job engineer. The wall top plate must be designed to support the loads applied to it (downward, upward and lateral).
- 5. Lateral allowable loads (P1 and P2) shown are maximum values. If these loads are in combination with an uplift load, contact a TrusSteel engineer.
- 6. The allowable loads outlined in this detail have not been increased by 1.33.
- 7. If used in Florida, this connection shall not be used in the High Velocity Hurricane Zone (HVHZ) per 2007 Florida Building Code (FBC).



## www.TrusSteel.com

Flortda: 1950 Marley Drive / Haines City, FL 33844 / (800) 755-6001 Missouri: 13389 Lakefront Drive / Earth City, MO 63045 / (800) 326-4102 California: 8351 Rovana Circle / Sacramento, CA 95828 / (800) 877-3678

# TSUC7 Uplift Attachment To Cold-Formed Steel

ITW Building Components Group, Inc. shall not be responsible for any performance failure in a connection due to a deviation from this detail. Any variation from this detail shall be approved in advance by ITW Building Components Group, Inc.

## Custom Detail:

TS-CD-TB-CF6-002

Date:

10/07/10

#### Custom Detail Category:

Truss-To-Bearing: Other