
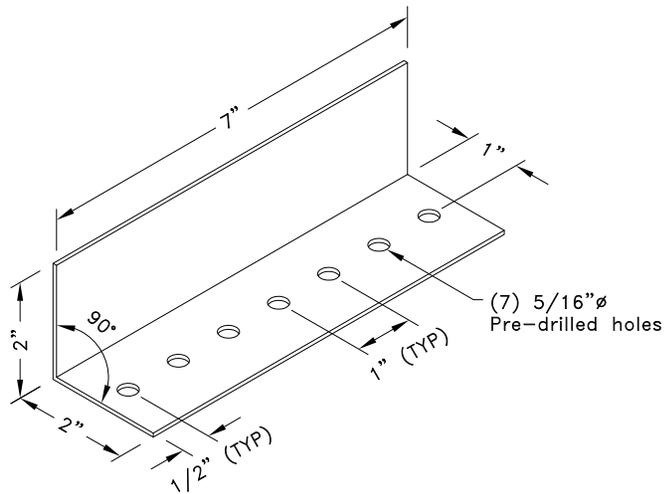


Maximum Uplift Capacity U, lbs.	
Wall top plate species	Clip on each face
Spruce-Pine-Fir	6700

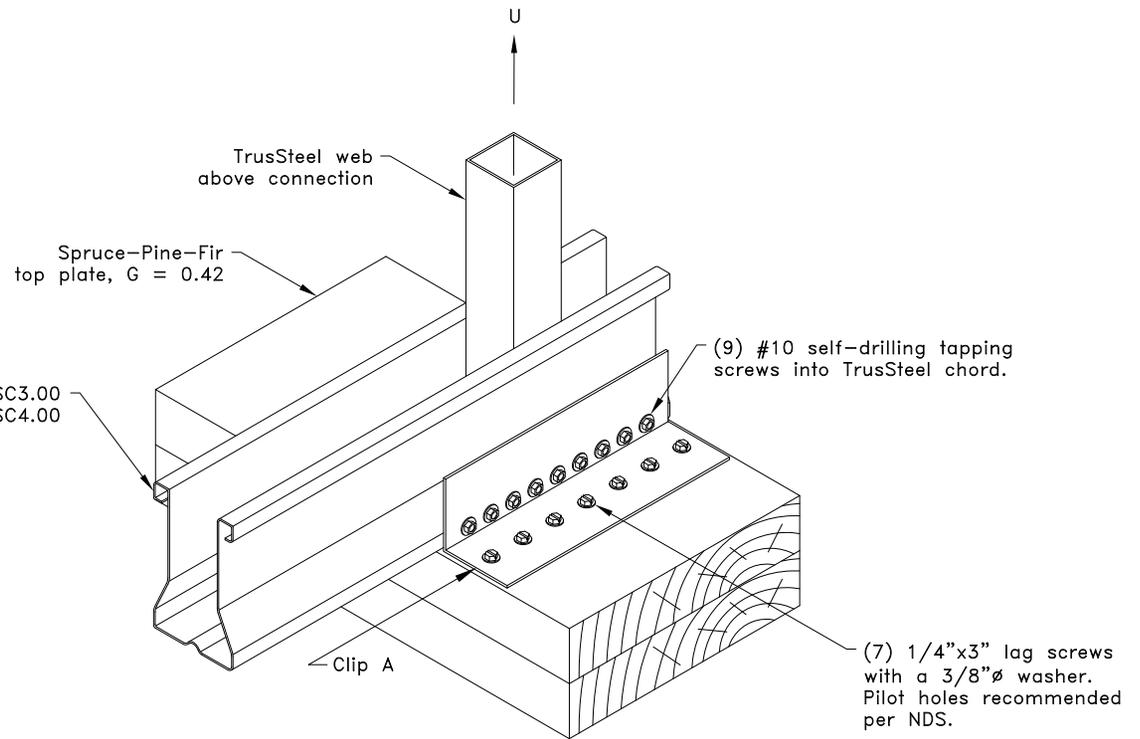

Clip A
 14g ASTM A653 SS Grade 33 G60
 Bare metal thickness: $t = 0.0677''$

General Notes:

1. SDS = Self-Drilling Tapping Screw
2. Screw end distance and edge distance is $9/32''$ minimum. Screw spacing is $9/16''$ minimum.
3. 2x8 or larger top plate is required.
4. Allowable fastener values into wood are per ANSI/AWC NDS-2012.
5. Attachment of second clip on opposite face of chord is identical to what is detailed.
6. Connection of top plate to wall stud must be capable of transferring truss uplift load from wall top plate to wall stud. (If applicable)
7. Allowable lag screw uplift load has been increased by 1.6 duration factor for wind and seismic loads.
8. If top plate is pressure treated lumber, contact a TrusSteel engineer for assistance.
9. Cold-Formed Steel Calculations are per the 2010 supplement to the AISI 2007 "North American Specification for the design of Cold-Formed Steel Structural Members" (S100-07/S2-10).

TrusSteel[®]

www.TrusSteel.com

Florida: 2400 Lake Orange Drive, Suite 150 / Orlando, FL 32837 / (800) 755-6001
 Missouri: 13389 Lakefront Drive / Earth City, MO 63045 / (800) 326-4102

**Uplift Attachment
 To Wood Double Top Plate**

ITW Building Components Group, Inc. shall not be responsible for any performance failure in a connection due to a deviation from this detail. Any variation from this detail shall be approved in advance by ITW Building Components Group, Inc.

Custom Detail:
 CD140803

Date:
 08/12/14

Custom Detail Category:
 Truss-To-Bearing: All Other Materials